


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 3 (A1)

Reporting of Continuously Monitored Emissions to Air for HCl mg/Nm3 at Emission Point A1 For the month of August 2025

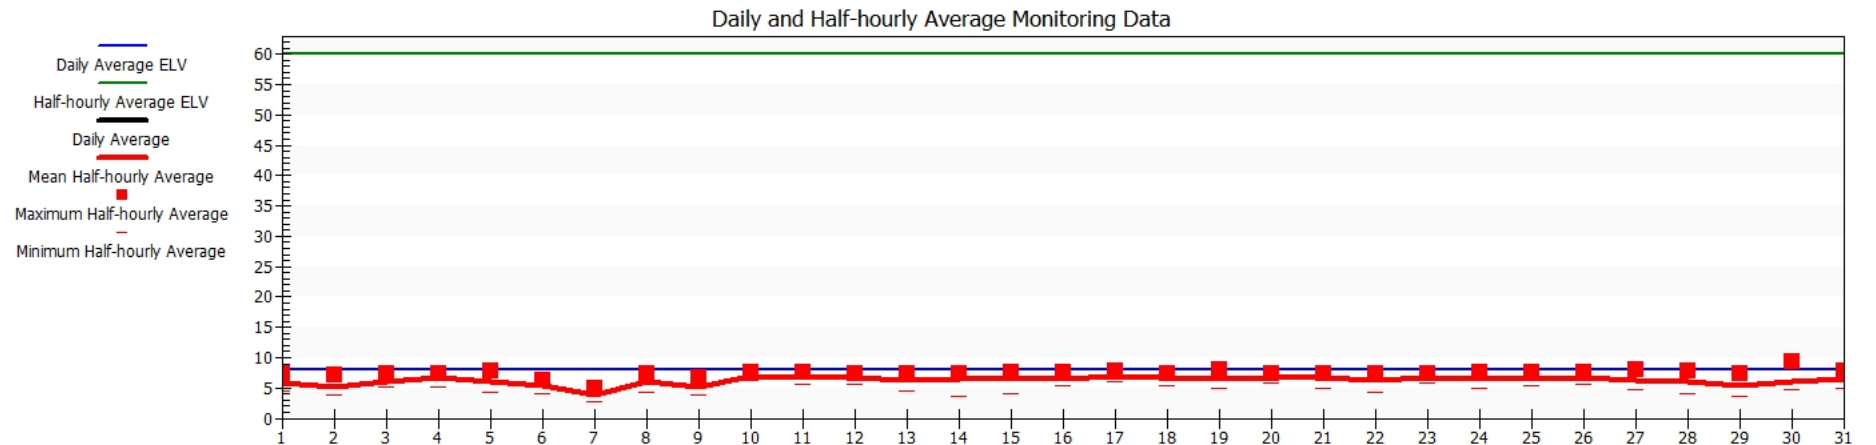

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0
	Monthly maximum	9.3	Maximum Half-hourly average	7.4	7.2	7.4	7.3	7.8	6.3	4.9	7.3	6.7	7.5	7.5	7.4	7.4	7.4	7.6	7.7	7.9	7.4	8.0	7.4	7.4	7.4	7.3	7.6	7.6	7.6	8.1	7.7	7.3	9.3	7.8
	Monthly mean	6.2	Mean Half-hourly average	5.7	5.2	6.1	6.6	6.0	5.3	3.9	6.1	5.2	6.9	6.7	6.7	6.2	6.5	6.4	6.5	6.8	6.8	6.5	6.7	6.7	6.3	6.7	6.5	6.4	6.7	6.3	6.0	5.3	6.0	6.4
	Monthly minimum	2.8	Minimum Half-hourly average	4.5	3.8	5.1	5.2	4.2	4.1	2.8	4.3	3.8	6.2	5.6	5.5	4.5	3.6	4.0	5.3	6.0	5.3	4.9	5.9	4.8	4.3	5.9	4.9	5.4	5.7	4.8	4.0	3.7	4.8	5.0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0
	Monthly maximum	6.9	Daily average	5.7	5.2	6.1	6.6	6.0	5.3	3.9	6.1	5.2	6.9	6.7	6.7	6.2	6.5	6.4	6.5	6.8	6.8	6.5	6.7	6.7	6.3	6.7	6.5	6.4	6.7	6.3	6.0	5.3	6.0	6.4
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....REDACTED.....

Date.....06.10.25.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 5 (A1)

Reporting of Continuously Monitored Emissions to Air for SO₂ mg/Nm³ at Emission Point A1 For the month of August 2025

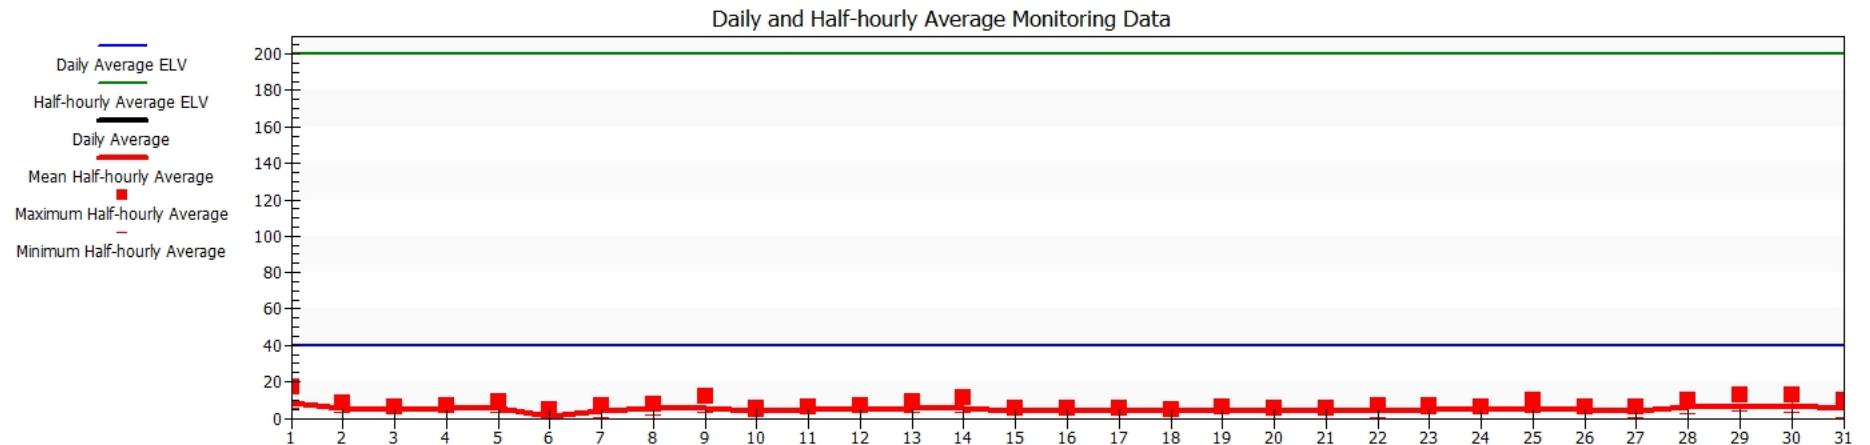

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200
	Monthly maximum	17	Maximum Half-hourly average	17	8	6	7	9	5	7	8	12	5	6	7	9	11	5	5	6	5	6	5	5	7	7	6	10	6	6	10	13	13	10
	Monthly mean	5	Mean Half-hourly average	8	5	5	5	5	1	4	5	5	4	5	5	5	5	4	4	5	4	4	4	4	4	5	5	5	5	4	6	6	7	6
	Monthly minimum	0	Minimum Half-hourly average	5	4	4	4	3	0	0	2	4	1	3	3	3	3	2	2	3	3	3	3	3	0	3	3	3	4	1	3	4	4	0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40
	Monthly maximum	8	Daily average	8	5	5	5	5	1	4	5	5	4	5	5	5	5	4	4	5	4	4	4	4	4	5	5	5	5	4	6	6	7	6
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....REDACTED.....

Date.....06.10.25.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 6 (A1)

Reporting of Continuously Monitored Emissions to Air for NOx mg/Nm3 at Emission Point A1 For the month of August 2025

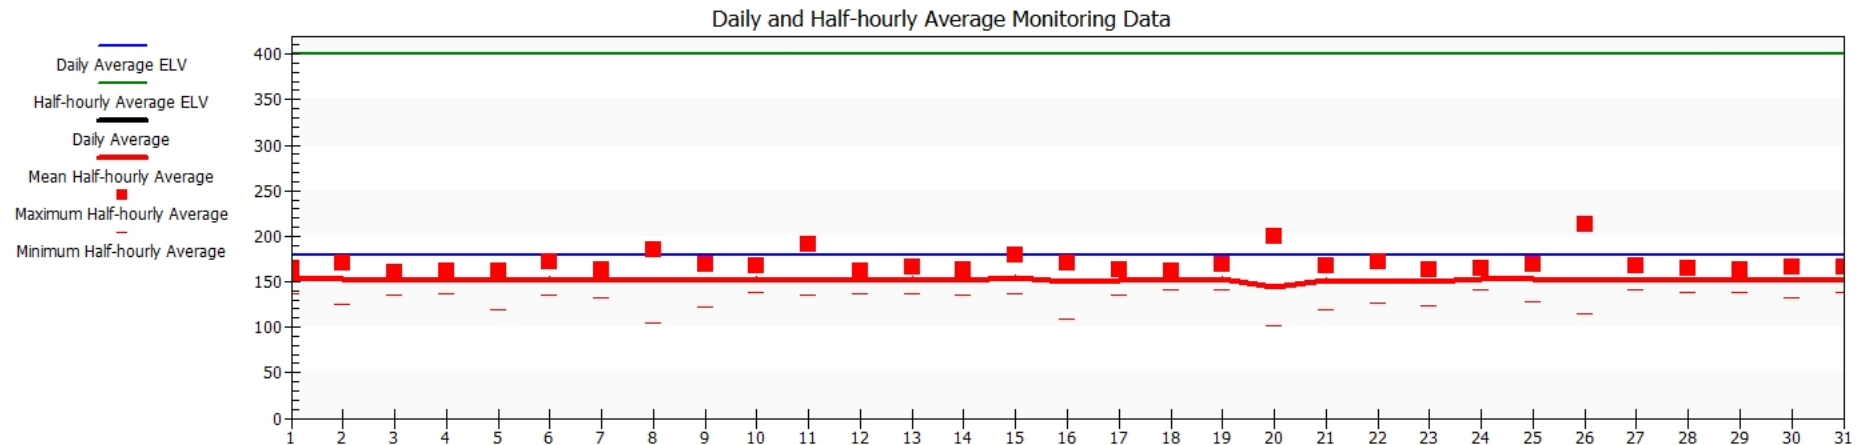

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400
	Monthly maximum	214	Maximum Half-hourly average	164	171	160	162	161	172	163	184	169	167	191	162	166	164	179	170	163	161	170	200	168	172	163	164	170	214	168	165	163	166	167
	Monthly mean	152	Mean Half-hourly average	153	152	151	152	151	153	151	152	151	153	152	152	153	152	154	150	152	151	152	144	152	151	151	153	152	152	152	152	152	152	152
	Monthly minimum	102	Minimum Half-hourly average	137	126	136	136	120	136	133	105	122	138	136	136	137	135	137	108	136	141	141	102	119	126	124	141	128	115	141	138	138	133	139
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180
	Monthly maximum	154	Daily average	153	152	151	152	151	153	151	152	151	153	152	152	153	152	154	150	152	151	152	144	152	151	151	153	152	152	152	152	152	152	152
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....REDACTED.....

Date.....06.10.25.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 2 (A1)

Reporting of Continuously Monitored Emissions to Air for TOC mg/Nm3 at Emission Point A1 For the month of August 2025

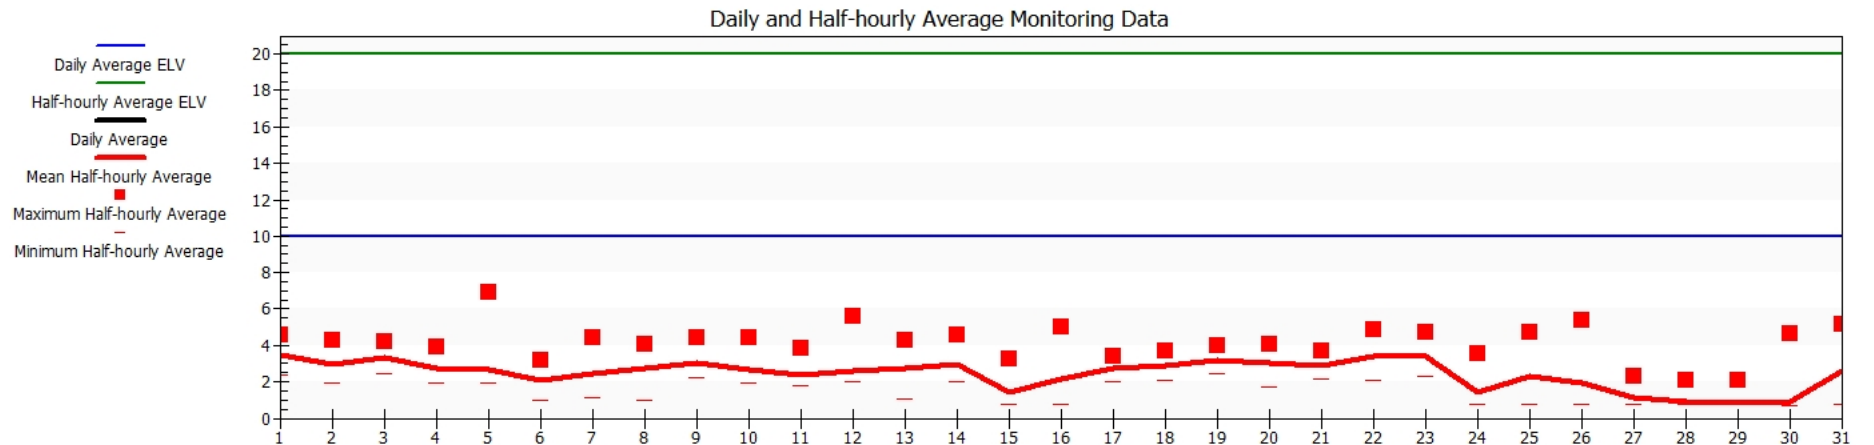

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0
	Monthly maximum	6.9	Maximum Half-hourly average	4.5	4.3	4.2	3.9	6.9	3.2	4.4	4.1	4.4	4.4	3.8	5.6	4.3	4.6	3.3	5.0	3.4	3.7	4.0	4.0	3.7	4.8	4.7	3.6	4.7	5.3	2.3	2.1	2.1	4.7	5.2
	Monthly mean	2.5	Mean Half-hourly average	3.5	2.9	3.3	2.8	2.6	2.1	2.5	2.8	3.0	2.7	2.4	2.6	2.7	3.0	1.4	2.2	2.8	2.9	3.2	3.1	2.9	3.4	3.4	1.4	2.3	2.0	1.2	0.9	0.8	0.9	2.6
	Monthly minimum	0.7	Minimum Half-hourly average	2.4	1.9	2.4	2.0	2.0	1.0	1.2	1.0	2.3	1.9	1.8	2.0	1.1	2.0	0.7	0.7	2.0	2.1	2.5	1.7	2.2	2.1	2.3	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
	Monthly maximum	3.5	Daily average	3.5	2.9	3.3	2.8	2.6	2.1	2.5	2.8	3.0	2.7	2.4	2.6	2.7	3.0	1.4	2.2	2.8	2.9	3.2	3.1	2.9	3.4	3.4	1.4	2.3	2.0	1.2	0.9	0.8	0.9	2.6
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....REDACTED.....

Date.....06.10.25.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 7 (A1)

Reporting of Continuously Monitored Emissions to Air for NH3 mg/Nm3 at Emission Point A1 For the month of August 2025

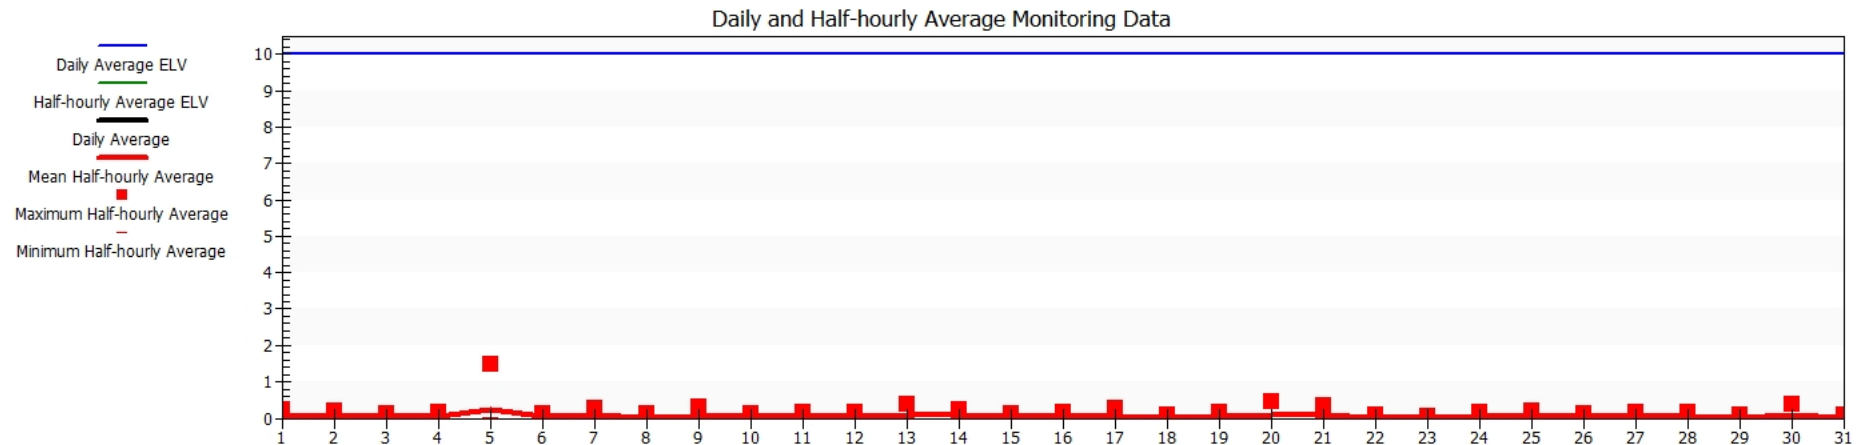

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	1.5	Maximum Half-hourly average	0.2	0.2	0.1	0.2	1.5	0.1	0.3	0.1	0.3	0.1	0.2	0.2	0.4	0.2	0.1	0.2	0.3	0.1	0.2	0.4	0.3	0.1	0.1	0.2	0.2	0.1	0.2	0.2	0.1	0.4	0.1
	Monthly mean	0.1	Mean Half-hourly average	0.1	0.1	0.1	0.1	0.2	0.1	0.1	0.0	0.0	0.1	0.1	0.0	0.1	0.1	0.0	0.1	0.1	0.0	0.1	0.1	0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.1	0.0	0.1	0.0
	Monthly minimum	0.0	Minimum Half-hourly average	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average			Daily average ELV	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
	Monthly maximum	0.2	Daily average	0.1	0.1	0.1	0.1	0.2	0.1	0.1	0.0	0.0	0.1	0.1	0.0	0.1	0.1	0.0	0.1	0.1	0.0	0.1	0.1	0.0	0.1	0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.1	0.0
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....REDACTED.....

Date.....06.10.25.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 1 (A1)

Reporting of Continuously Monitored Emissions to Air for Particulates mg/Nm3 at Emission Point A1 For the month of August 2025

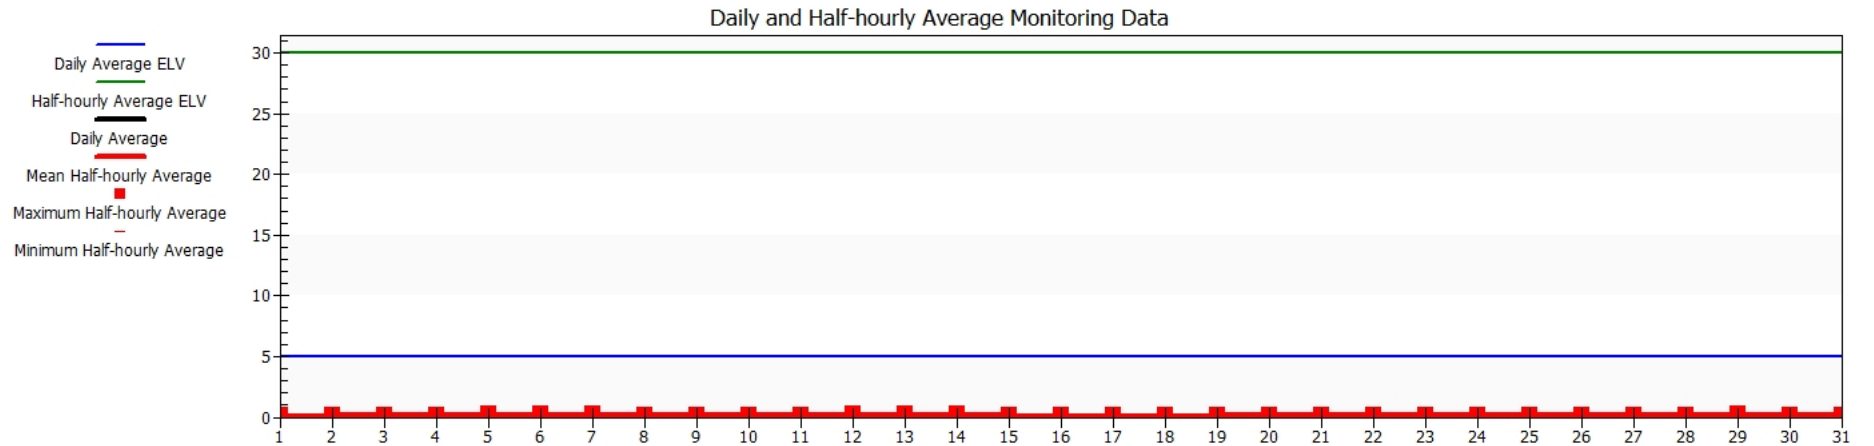

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
	Monthly maximum	0.3	Maximum Half-hourly average	0.1	0.2	0.2	0.2	0.3	0.3	0.2	0.2	0.2	0.1	0.2	0.2	0.3	0.3	0.2	0.1	0.1	0.1	0.2	0.2	0.2	0.2	0.2	0.1	0.2	0.2	0.2	0.2	0.2	0.2	0.2
	Monthly mean	0.1	Mean Half-hourly average	0.1	0.1	0.1	0.2	0.1	0.2	0.2	0.1	0.1	0.1	0.1	0.2	0.2	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.1	0.1
	Monthly minimum	0.1	Minimum Half-hourly average	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0
	Monthly maximum	0.2	Daily average	0.1	0.1	0.1	0.2	0.1	0.2	0.2	0.1	0.1	0.1	0.1	0.2	0.2	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.1	0.1
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....REDACTED.....

Date.....06.10.25.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 8 (A1)

Reporting of Continuously Monitored Emissions to Air for N2O mg/Nm3 at Emission Point A1 For the month of August 2025

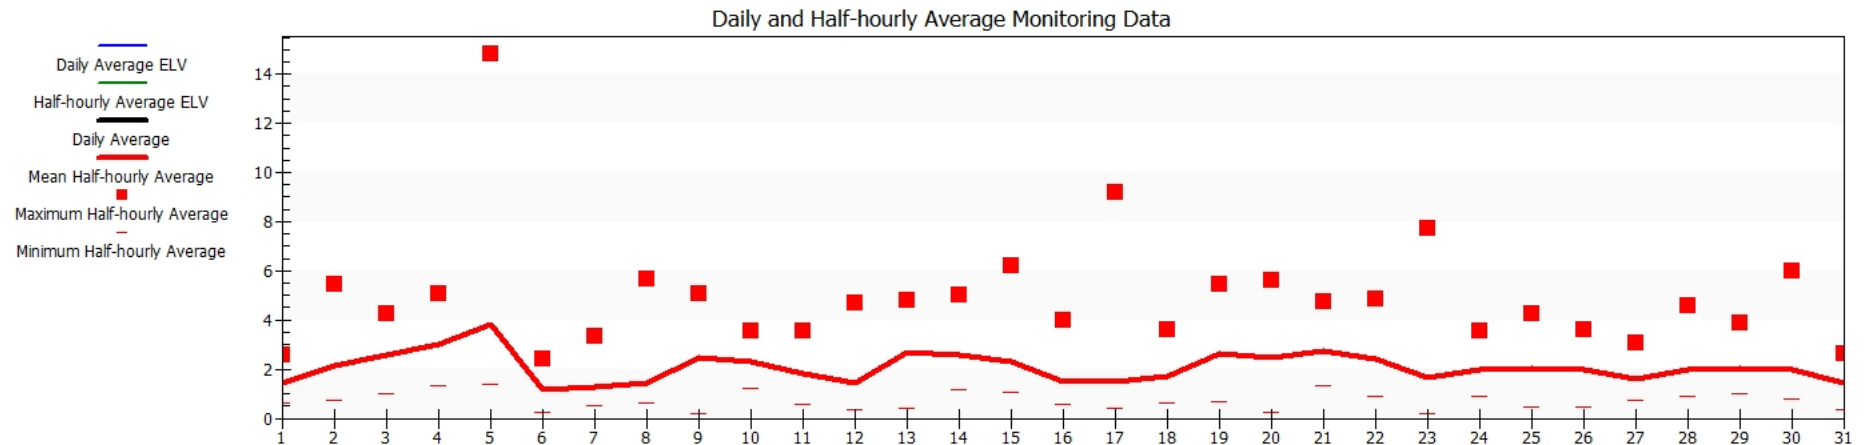

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	14.8	Maximum Half-hourly average	2.6	5.4	4.3	5.1	14.8	2.4	3.3	5.7	5.1	3.5	3.6	4.7	4.8	5.0	6.2	4.0	9.2	3.6	5.4	5.6	4.7	4.9	7.7	3.6	4.2	3.6	3.0	4.6	3.9	6.0	2.6
	Monthly mean	2.1	Mean Half-hourly average	1.4	2.1	2.6	3.0	3.8	1.2	1.3	1.4	2.4	2.3	1.8	1.5	2.7	2.6	2.3	1.5	1.5	1.7	2.6	2.5	2.7	2.4	1.6	2.0	2.1	2.0	1.6	2.0	2.0	2.0	1.4
	Monthly minimum	0.2	Minimum Half-hourly average	0.6	0.7	1.0	1.3	1.4	0.2	0.5	0.6	0.2	1.2	0.6	0.3	0.4	1.2	1.1	0.6	0.4	0.6	0.7	0.2	1.3	0.9	0.2	0.9	0.5	0.5	0.8	0.9	1.0	0.8	0.4
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average			Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	3.8	Daily average	1.4	2.1	2.6	3.0	3.8	1.2	1.3	1.4	2.4	2.3	1.8	1.5	2.7	2.6	2.3	1.5	1.5	1.7	2.6	2.5	2.7	2.4	1.6	2.0	2.1	2.0	1.6	2.0	2.0	2.0	1.4
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....REDACTED.....

Date.....06.10.25.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air A (A1)

Reporting of Continuously Monitored Emissions to Air for CO2 % at Emission Point A1 For the month of August 2025

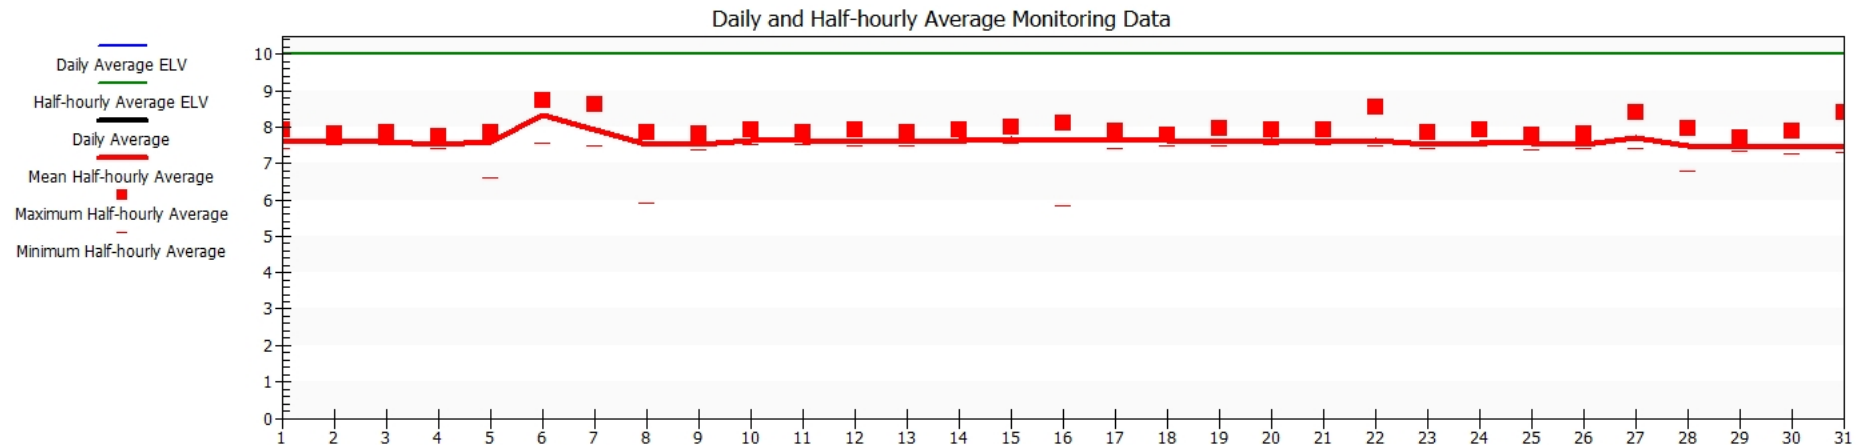

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
	Monthly maximum	9	Maximum Half-hourly average	8	8	8	8	8	9	9	8	8	8	8	8	8	8	8	8	8	8	8	8	8	9	8	8	8	8	8	8	8	8	8
	Monthly mean	8	Mean Half-hourly average	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	7	7	7	7
	Monthly minimum	6	Minimum Half-hourly average	7	8	8	7	7	8	7	6	7	8	8	7	7	8	8	6	7	7	7	8	8	7	7	7	7	7	7	7	7	7	7
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	8	Daily average	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	7	7	7	7
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....REDACTED.....

Date.....06.10.25.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air B (A1)

Reporting of Continuously Monitored Emissions to Air for Dry Oxygen % at Emission Point A1 For the month of August 2025

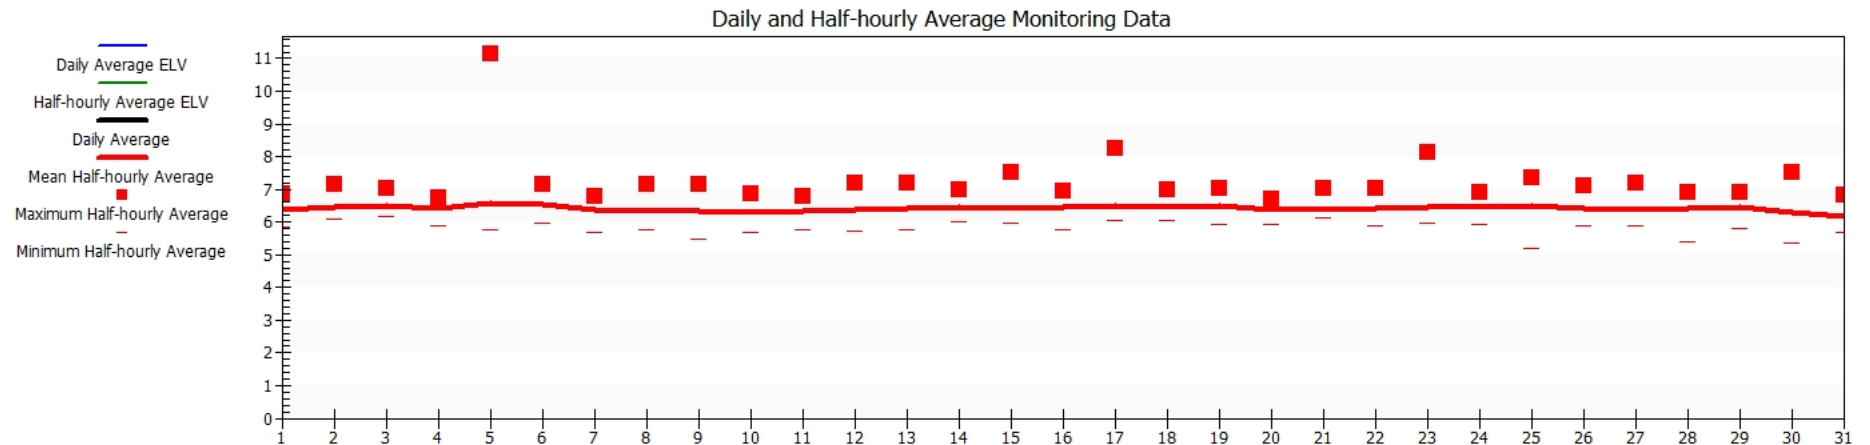

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	11	Maximum Half-hourly average	7	7	7	7	11	7	7	7	7	7	7	7	7	7	8	7	8	7	7	7	7	7	8	7	7	7	7	7	7	8	7	
	Monthly mean	6	Mean Half-hourly average	6	6	6	6	7	7	6	6	6	6	6	6	6	6	6	6	7	6	6	6	6	6	6	6	7	6	6	6	6	6	6	
	Monthly minimum	5	Minimum Half-hourly average	6	6	6	6	6	6	6	6	5	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	5	6	6	5	6	5	6	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average			Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	7	Daily average	6	6	6	6	7	7	6	6	6	6	6	6	6	6	6	6	7	6	6	6	6	6	6	6	7	6	6	6	6	6	6	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....REDACTED.....

Date.....06.10.25.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air C (A1)

Reporting of Continuously Monitored Emissions to Air for Moisture % at Emission Point A1 For the month of August 2025

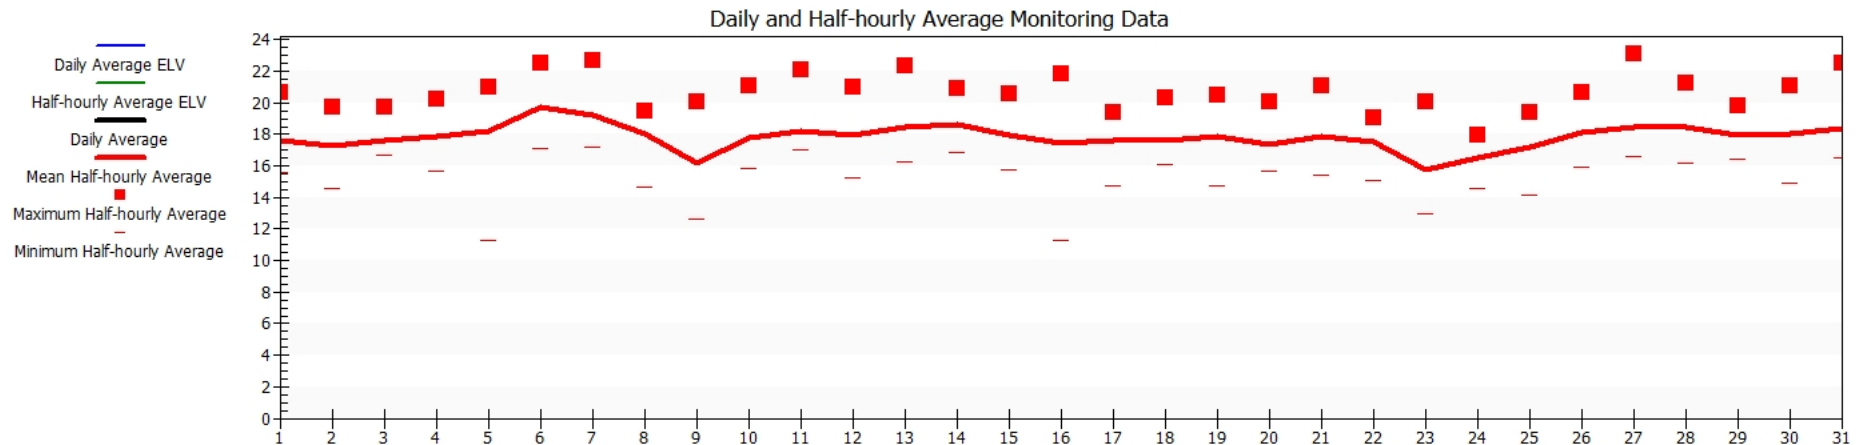

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	23	Maximum Half-hourly average	21	20	20	20	21	23	23	20	20	21	22	21	22	21	21	22	19	20	20	20	21	19	20	18	19	21	23	21	20	21	22
	Monthly mean	18	Mean Half-hourly average	18	17	18	18	18	20	19	18	16	18	18	18	18	19	18	17	18	18	18	17	18	18	16	16	17	18	19	18	18	18	18
	Monthly minimum	11	Minimum Half-hourly average	16	15	17	16	11	17	17	15	13	16	17	15	16	17	16	11	15	16	15	16	15	15	13	15	14	16	17	16	16	15	17
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average			Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	20	Daily average	18	17	18	18	18	20	19	18	16	18	18	18	18	19	18	17	18	18	18	17	18	18	16	16	17	18	19	18	18	18	18
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....REDACTED.....

Date.....06.10.25.....


(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 4 (A1)

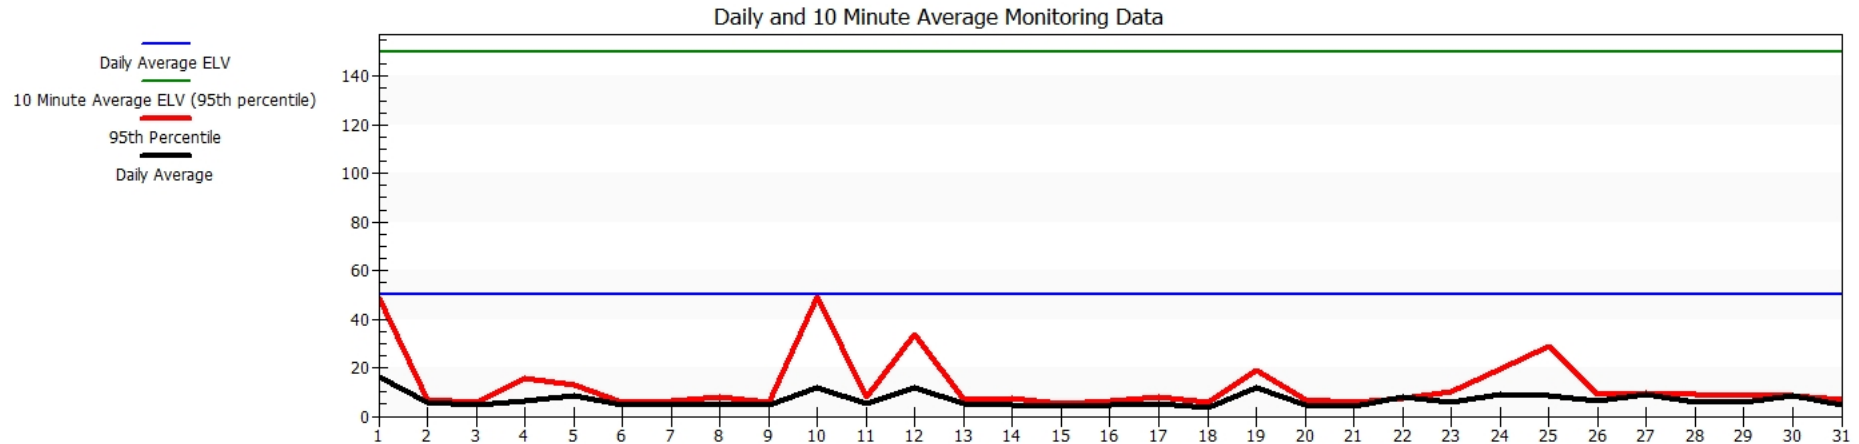Reporting of Continuously Monitored Emissions to Air for CO mg/Nm3 at Emission Point A1 For the month of August 2025

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
10 Minute average			10 Minute average ELV (95th Percentile)	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150
	Monthly Maximum 10-min	563	Maximum 10 Minute average	563	119	90	195	419	61	73	125	63	307	191	344	122	66	55	206	135	41	436	10	47	205	96	174	220	51	218	51	34	279	14
	Monthly mean 10-min avgs	7	95th Percentile	49	7	6	15	13	6	6	8	6	49	8	34	7	7	5	6	8	6	19	7	6	7	10	20	29	9	10	9	8	9	7
	Monthly Minimum 10-min	0	Minimum 10 Minute average	2	1	2	2	2	1	1	1	2	1	1	2	1	1	2	0	1	1	2	1	2	2	2	2	1	2	3	2	2	2	3
	Total Invalid results	5	No of Invalid results	0	0	0	0	0	1	0	4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
			Number of results above 150mg/m³	4	0	0	1	2	0	0	0	0	4	1	3	0	0	0	1	0	0	2	0	0	1	0	2	2	0	1	0	0	1	0
	Sum of Exceedances of 95th percentile ELV	0	95th Percentile ELV Exceeded (Y/N)	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
	Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50
Monthly maximum		16	Daily average	16	6	4	6	9	4	5	5	4	12	5	12	5	5	4	5	5	4	12	4	4	8	6	9	8	6	9	6	6	8	5
No of invalid days		0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
Sum of exceedances		0	Value Exceeds ELV? (Y/N)	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....REDACTED.....

Date.....06.10.25.....

(Authorised to sign as a representative of the Operator)

Environment Agency explanatory note: The 10-minute average ELV is based on the "95th percentile" In this case this means that 95% of the 10 minute averages in the calendar day (= 137) must be below 150 mg/m3, and 5% (= 7) are allowed to be any value above 150 mg/m3. Whilst we expect operators to minimise CO emissions at all times, it is perfectly acceptable for the value of the maximum 10-minute average to be above 150 mg/m3, provided the 95th percentile ELV has been met for that period